


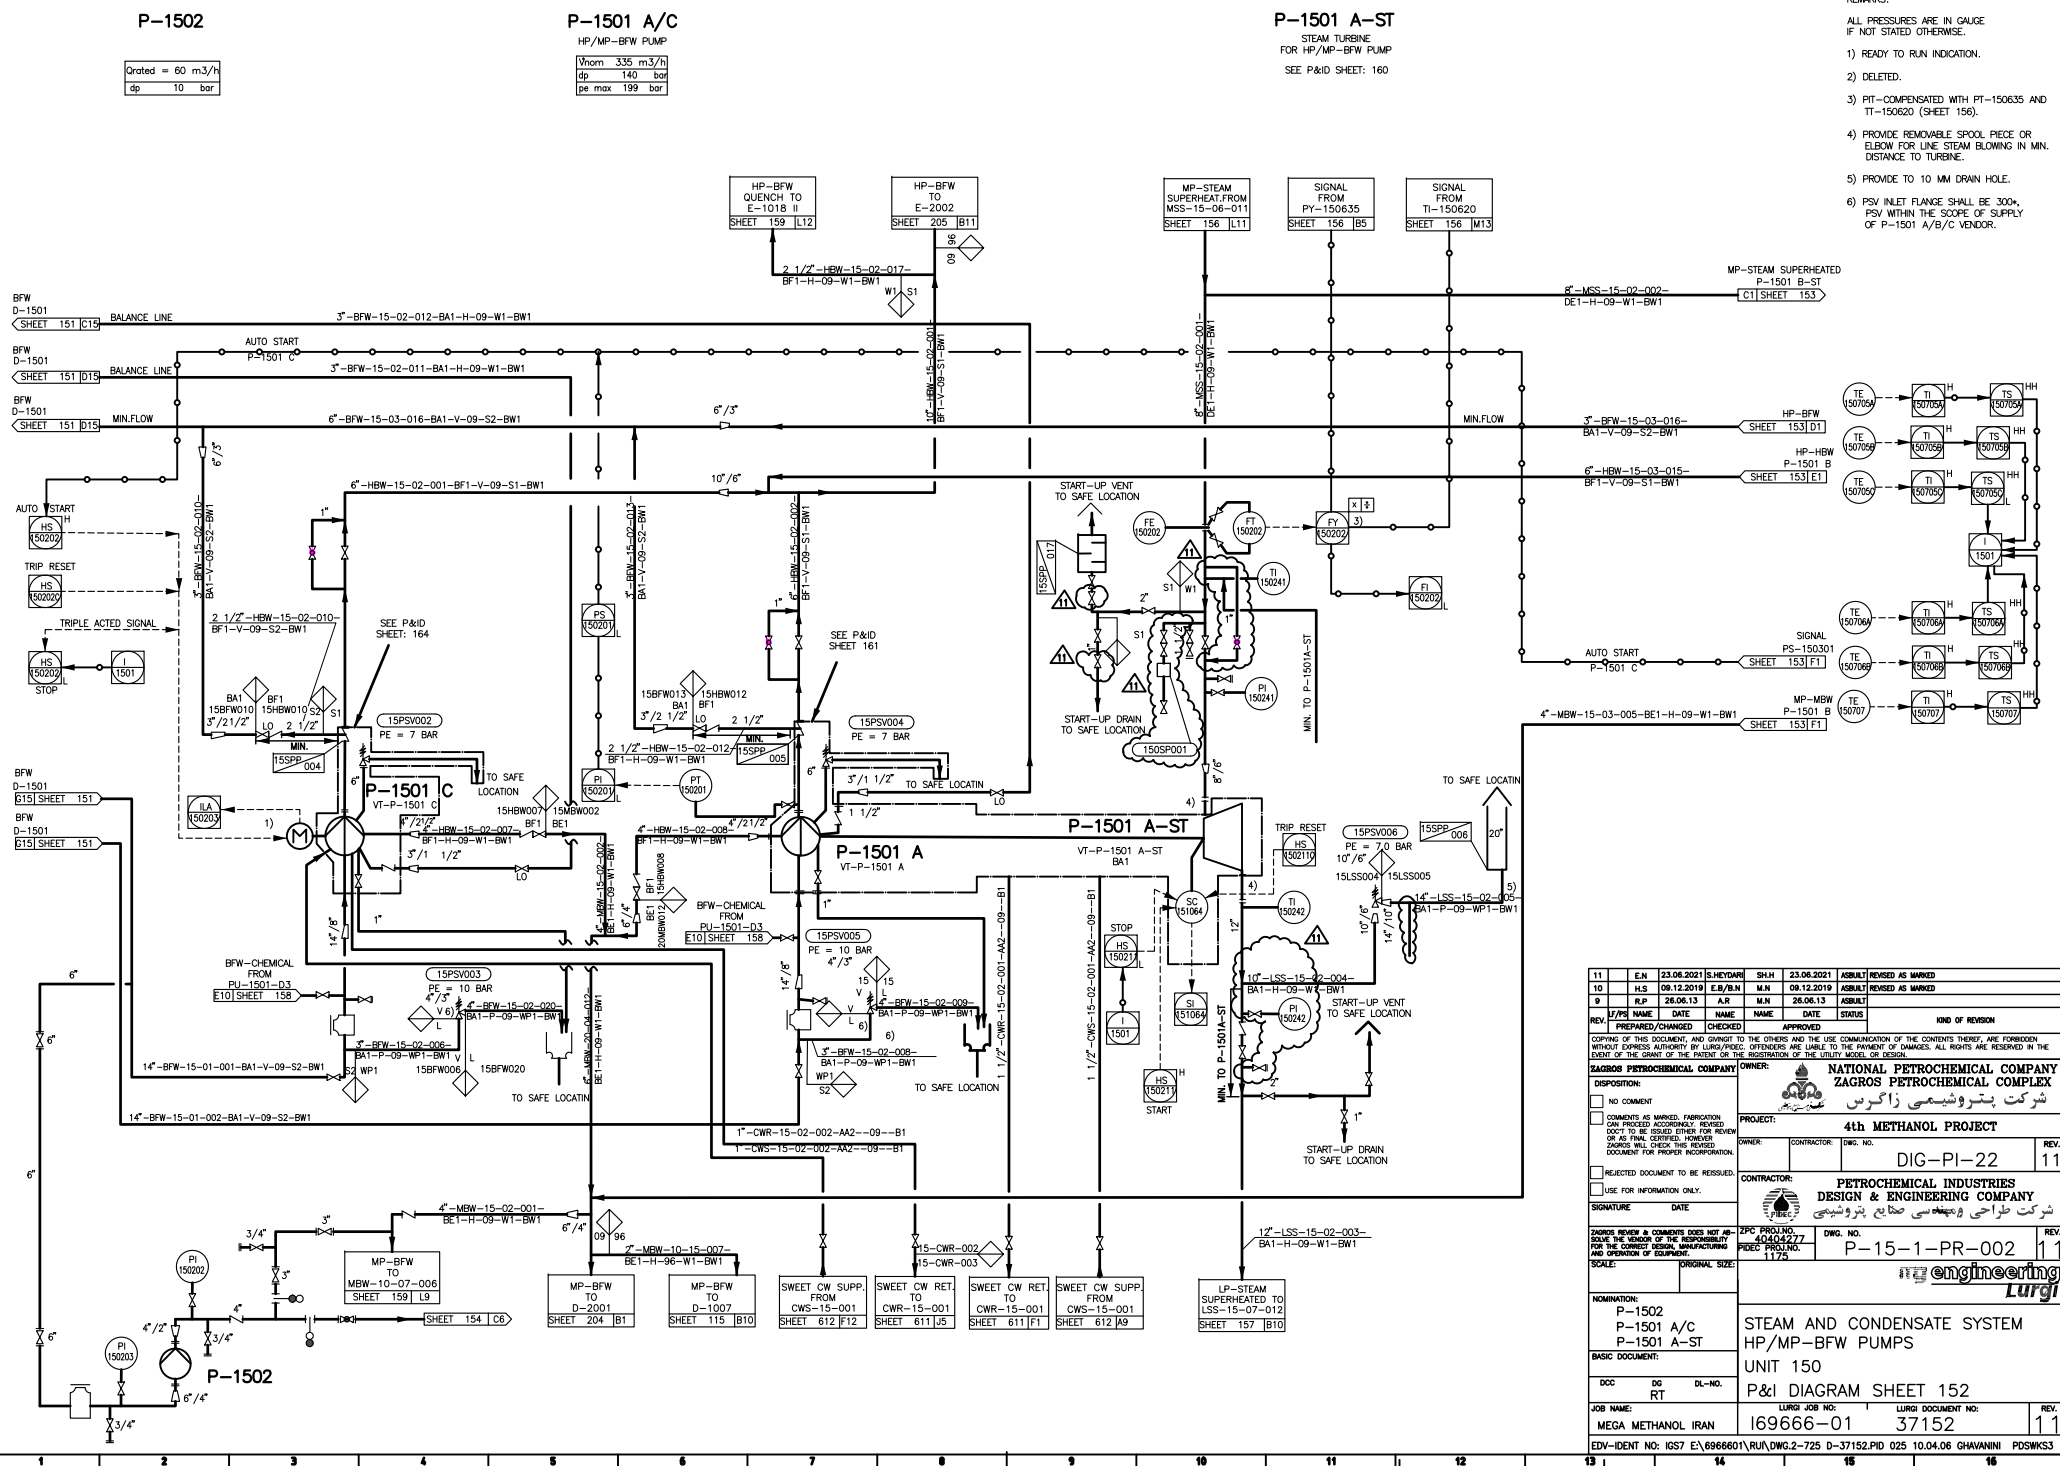

REMARKS:

ALL PRESSURES ARE IN GAUGE
IF NOT STATED OTHERWISE.

1) READY TO RUN INDICATION

2) DELETED

3) PIT-COMPENSATED WITH PT-150635 AND TT-150620 (SHEET 156).

4) PROVIDE REMOVABLE SPOOL PIECE OR ELBOW FOR LINE STEAM BLOWING IN MIN DISTANCE TO TURBINE.

5) PROVIDE TO 10 MM DRAIN HOLE.

6) PSV INLET FLANGE SHALL BE 300*,
PSV WITHIN THE SCOPE OF SUPPLY
OF P-1501 A/B/C VENDOR.