


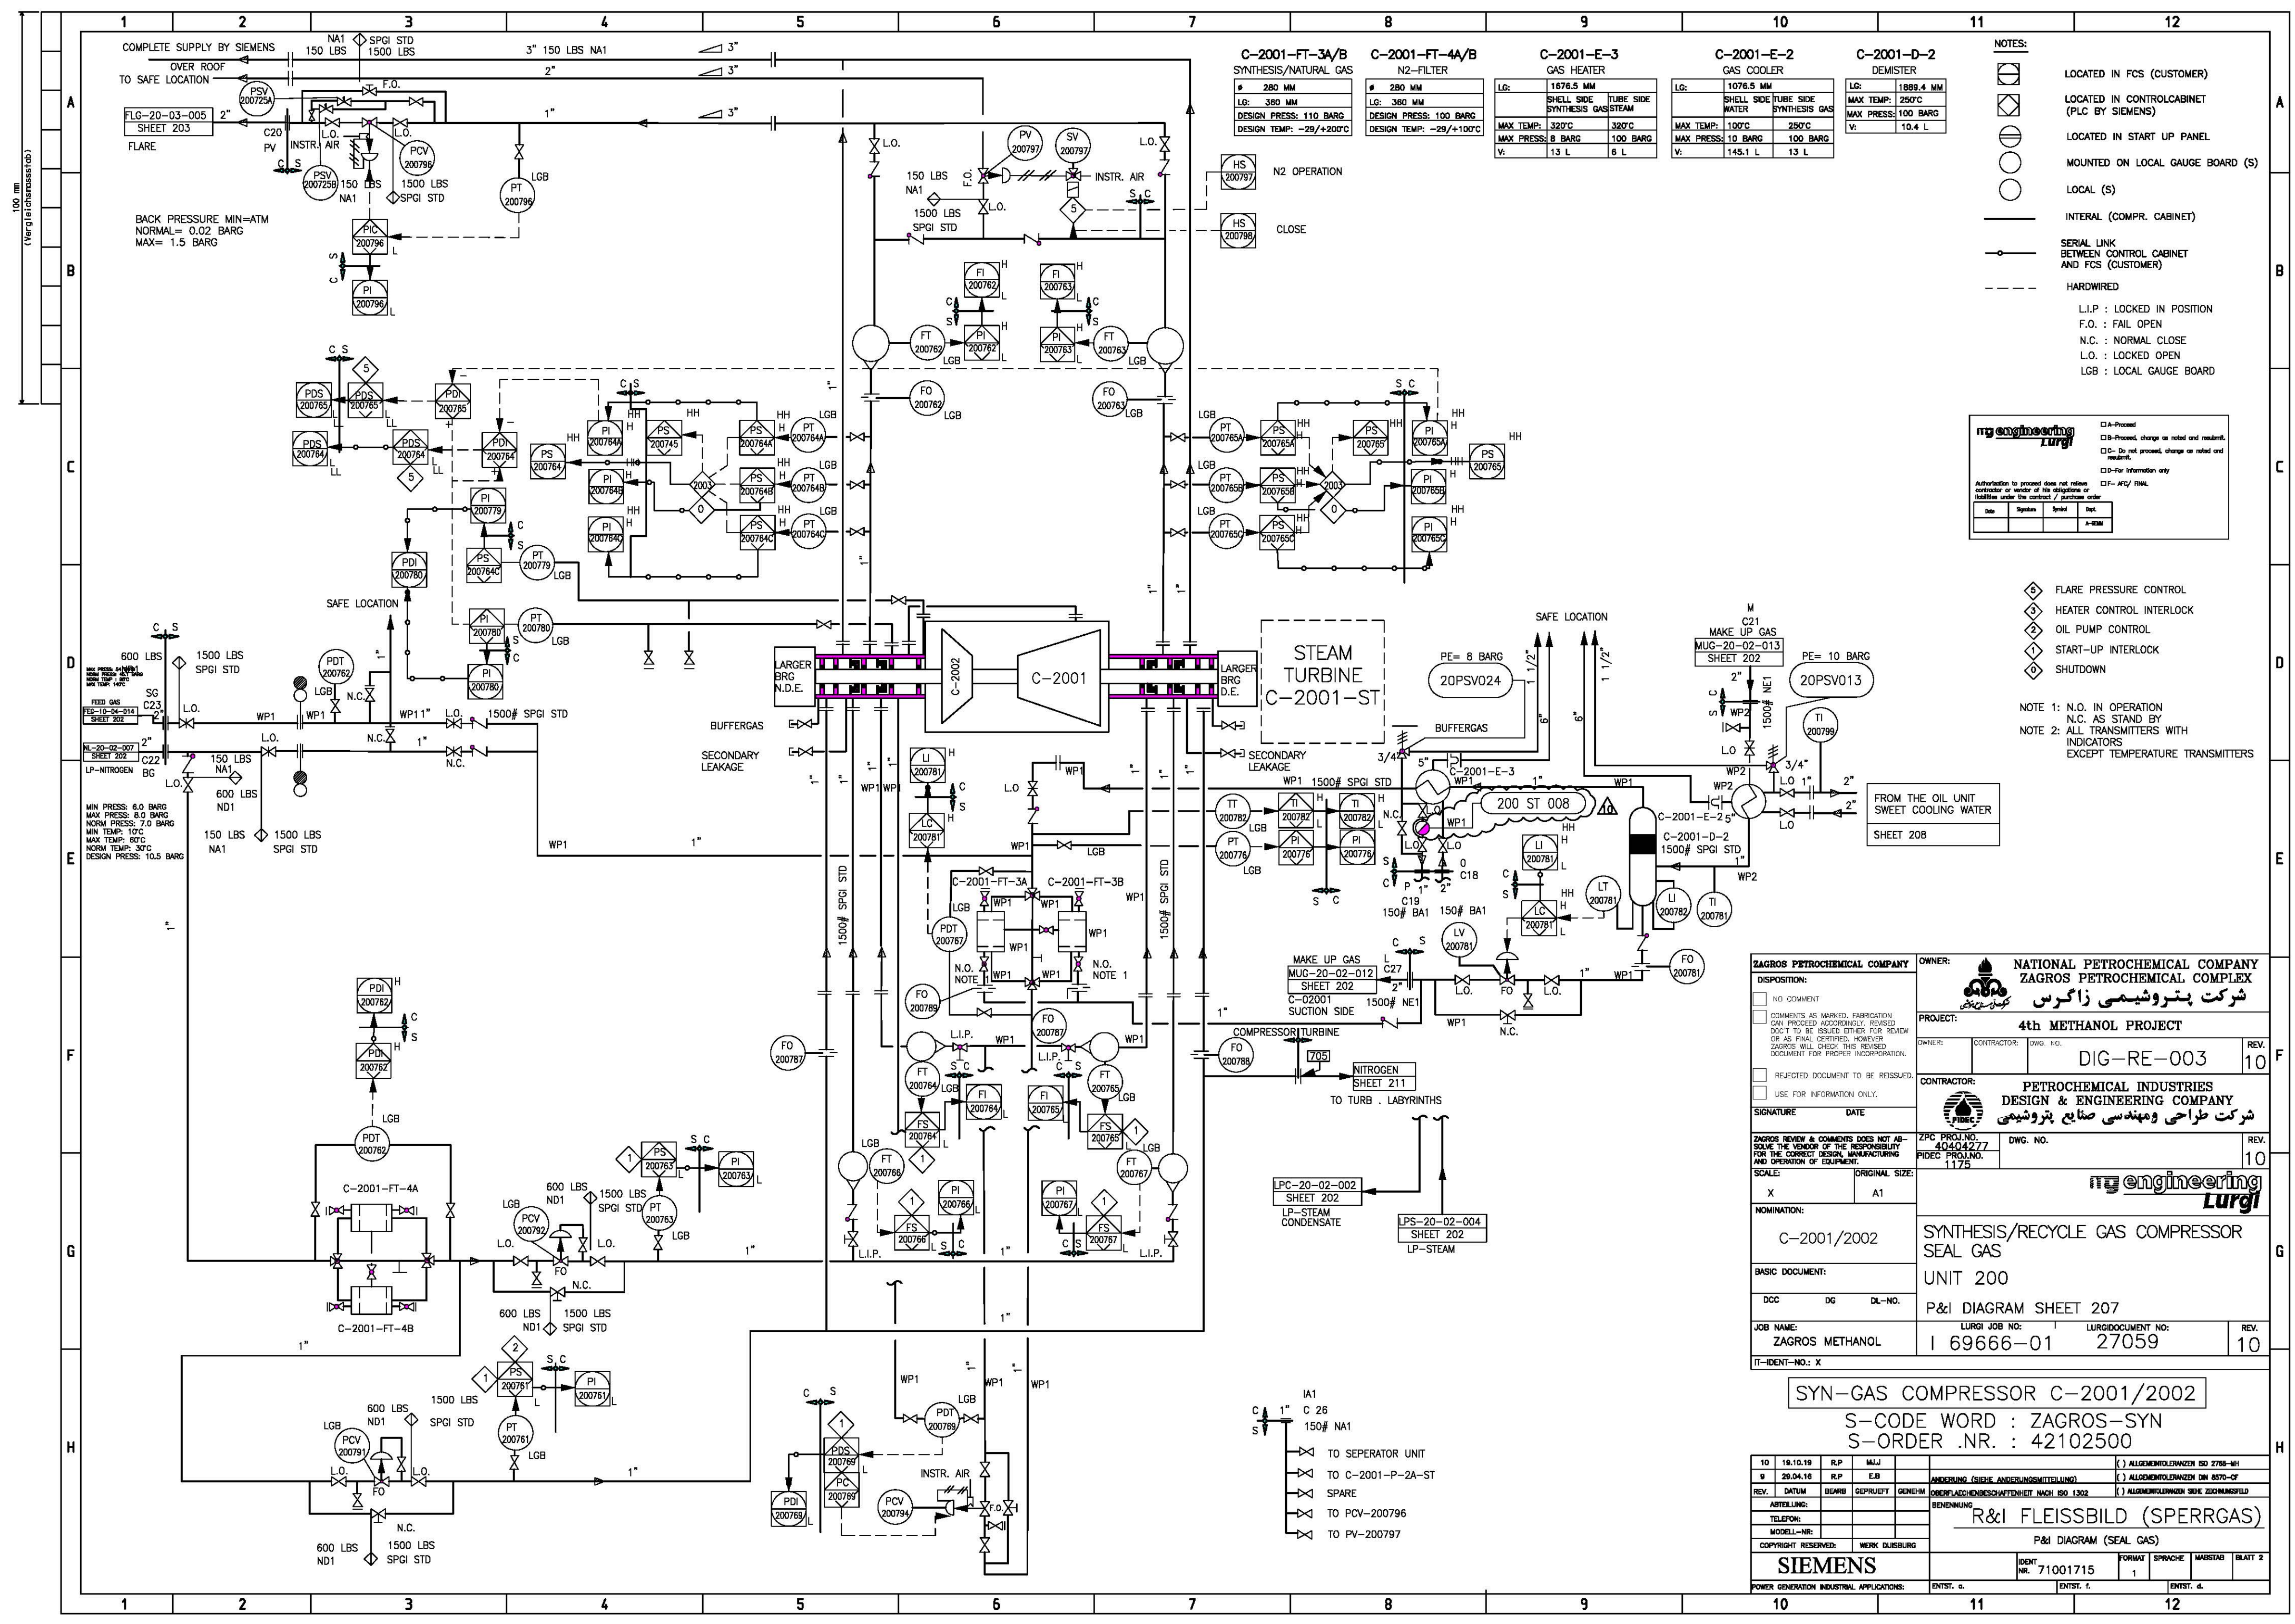

- NOTES:
- LOCATED IN FCS (CUSTOMER)
 - LOCATED IN CONTROL CABINET (PLC BY SIEMENS)
 - LOCATED IN START UP PANEL
 - MOUNTED ON LOCAL GAUGE BOARD (S)
 - LOCAL (S)
 - INTERNAL (COMPR. CABINET)
 - SERIAL LINK BETWEEN CONTROL CABINET AND FCS (CUSTOMER)
 - HARDWIRED
 - L.I.P. : LOCKED IN POSITION
 - F.O. : FAIL OPEN
 - N.C. : NORMAL CLOSE
 - L.O. : LOCKED OPEN
 - LGB : LOCAL GAUGE BOARD

my engineering Lurgi

Authorization to proceed does not release contractor or vendor of his obligation or liabilities under the contract / purchase order.

Date	Signature	Symbol	Dept.
			A-ENR

- FLARE PRESSURE CONTROL
 - HEATER CONTROL INTERLOCK
 - OIL PUMP CONTROL
 - START-UP INTERLOCK
 - SHUTDOWN
- NOTE 1: N.O. IN OPERATION
N.C. AS STAND BY
NOTE 2: ALL TRANSMITTERS WITH INDICATORS EXCEPT TEMPERATURE TRANSMITTERS

ZAGROS PETROCHEMICAL COMPANY		OWNER: NATIONAL PETROCHEMICAL COMPANY ZAGROS PETROCHEMICAL COMPLEX شرکت پتروشیمی زاگرس	
DISPOSITION: ☐ NO COMMENT ☐ COMMENTS AS MARKED, FABRICATION CAN PROCEED ACCORDINGLY, REVISED DOCT TO BE ISSUED EITHER FOR REVIEW OR AS FINAL CERTIFIED, HOWEVER ZAGROS WILL CHECK THIS REVISED DOCUMENT FOR PROPER INCORPORATION. ☐ REJECTED DOCUMENT TO BE REISSUED. ☐ USE FOR INFORMATION ONLY.		PROJECT: 4th METHANOL PROJECT OWNER: CONTRACTOR: DWG. NO. DIG-RE-003 REV. 10	
SIGNATURE _____ DATE _____		CONTRACTOR: PETROCHEMICAL INDUSTRIES DESIGN & ENGINEERING COMPANY شرکت طراحی و مهندسی صنایع پتروشیمی ZPC PROJ. NO. 40404277 PIDEC PROJ. NO. 1175 DWG. NO. 10	
ZAGROS REVIEW & COMMENTS DOES NOT ABSOLVE THE VENDOR OF THE RESPONSIBILITY FOR THE CORRECT DESIGN, MANUFACTURING AND OPERATION OF EQUIPMENT.		SCALE: X ORIGINAL SIZE: A1	
NOMINATION: C-2001/2002		SYNTHESIS/RECYCLE GAS COMPRESSOR SEAL GAS	
BASIC DOCUMENT: DCC DG DL-NO.		P&I DIAGRAM SHEET 207	
JOB NAME: ZAGROS METHANOL		LURGI JOB NO: I 69666-01 LURGI DOCUMENT NO: 27059 REV. 10	
IT-IDENT-NO.: X			

SYN-GAS COMPRESSOR C-2001/2002
S-CODE WORD : ZAGROS-SYN
S-ORDER .NR. : 42102500

10	19.10.19	R.P.	M.J.J.			() ALLOMENTIEREN/ANZEIGEN ISO 2768-MH
9	20.04.16	R.P.	E.B.			() ALLOMENTIEREN/ANZEIGEN DIN 8570-OF
REV.	DATUM	BEARB.	GEPRUEFT	GEHEIM	ANDERUNG (SIEHE ANDERUNGSMITTEILUNG)	() ALLOMENTIEREN/ANZEIGEN DIN 8570-OF
ABTEILUNG:					OBERFLAEBEN/BEHAEFTIGHEIT NACH ISO 1302	() ALLOMENTIEREN/ANZEIGEN DIN 8570-OF
TELEFON:					BENENNUNG	
MODELL-NR.:					P&I DIAGRAM (SEAL GAS)	
COPYRIGHT RESERVED:					WERK DUISBURG	
SIEMENS						
POWER GENERATION INDUSTRIAL APPLICATIONS:						
ENTST. a.					ENTST. f.	ENTST. d.
IDENT. NR. 71001715					FORMAT	SPRACHE
					1	MASSSTAB
						BLATT 2