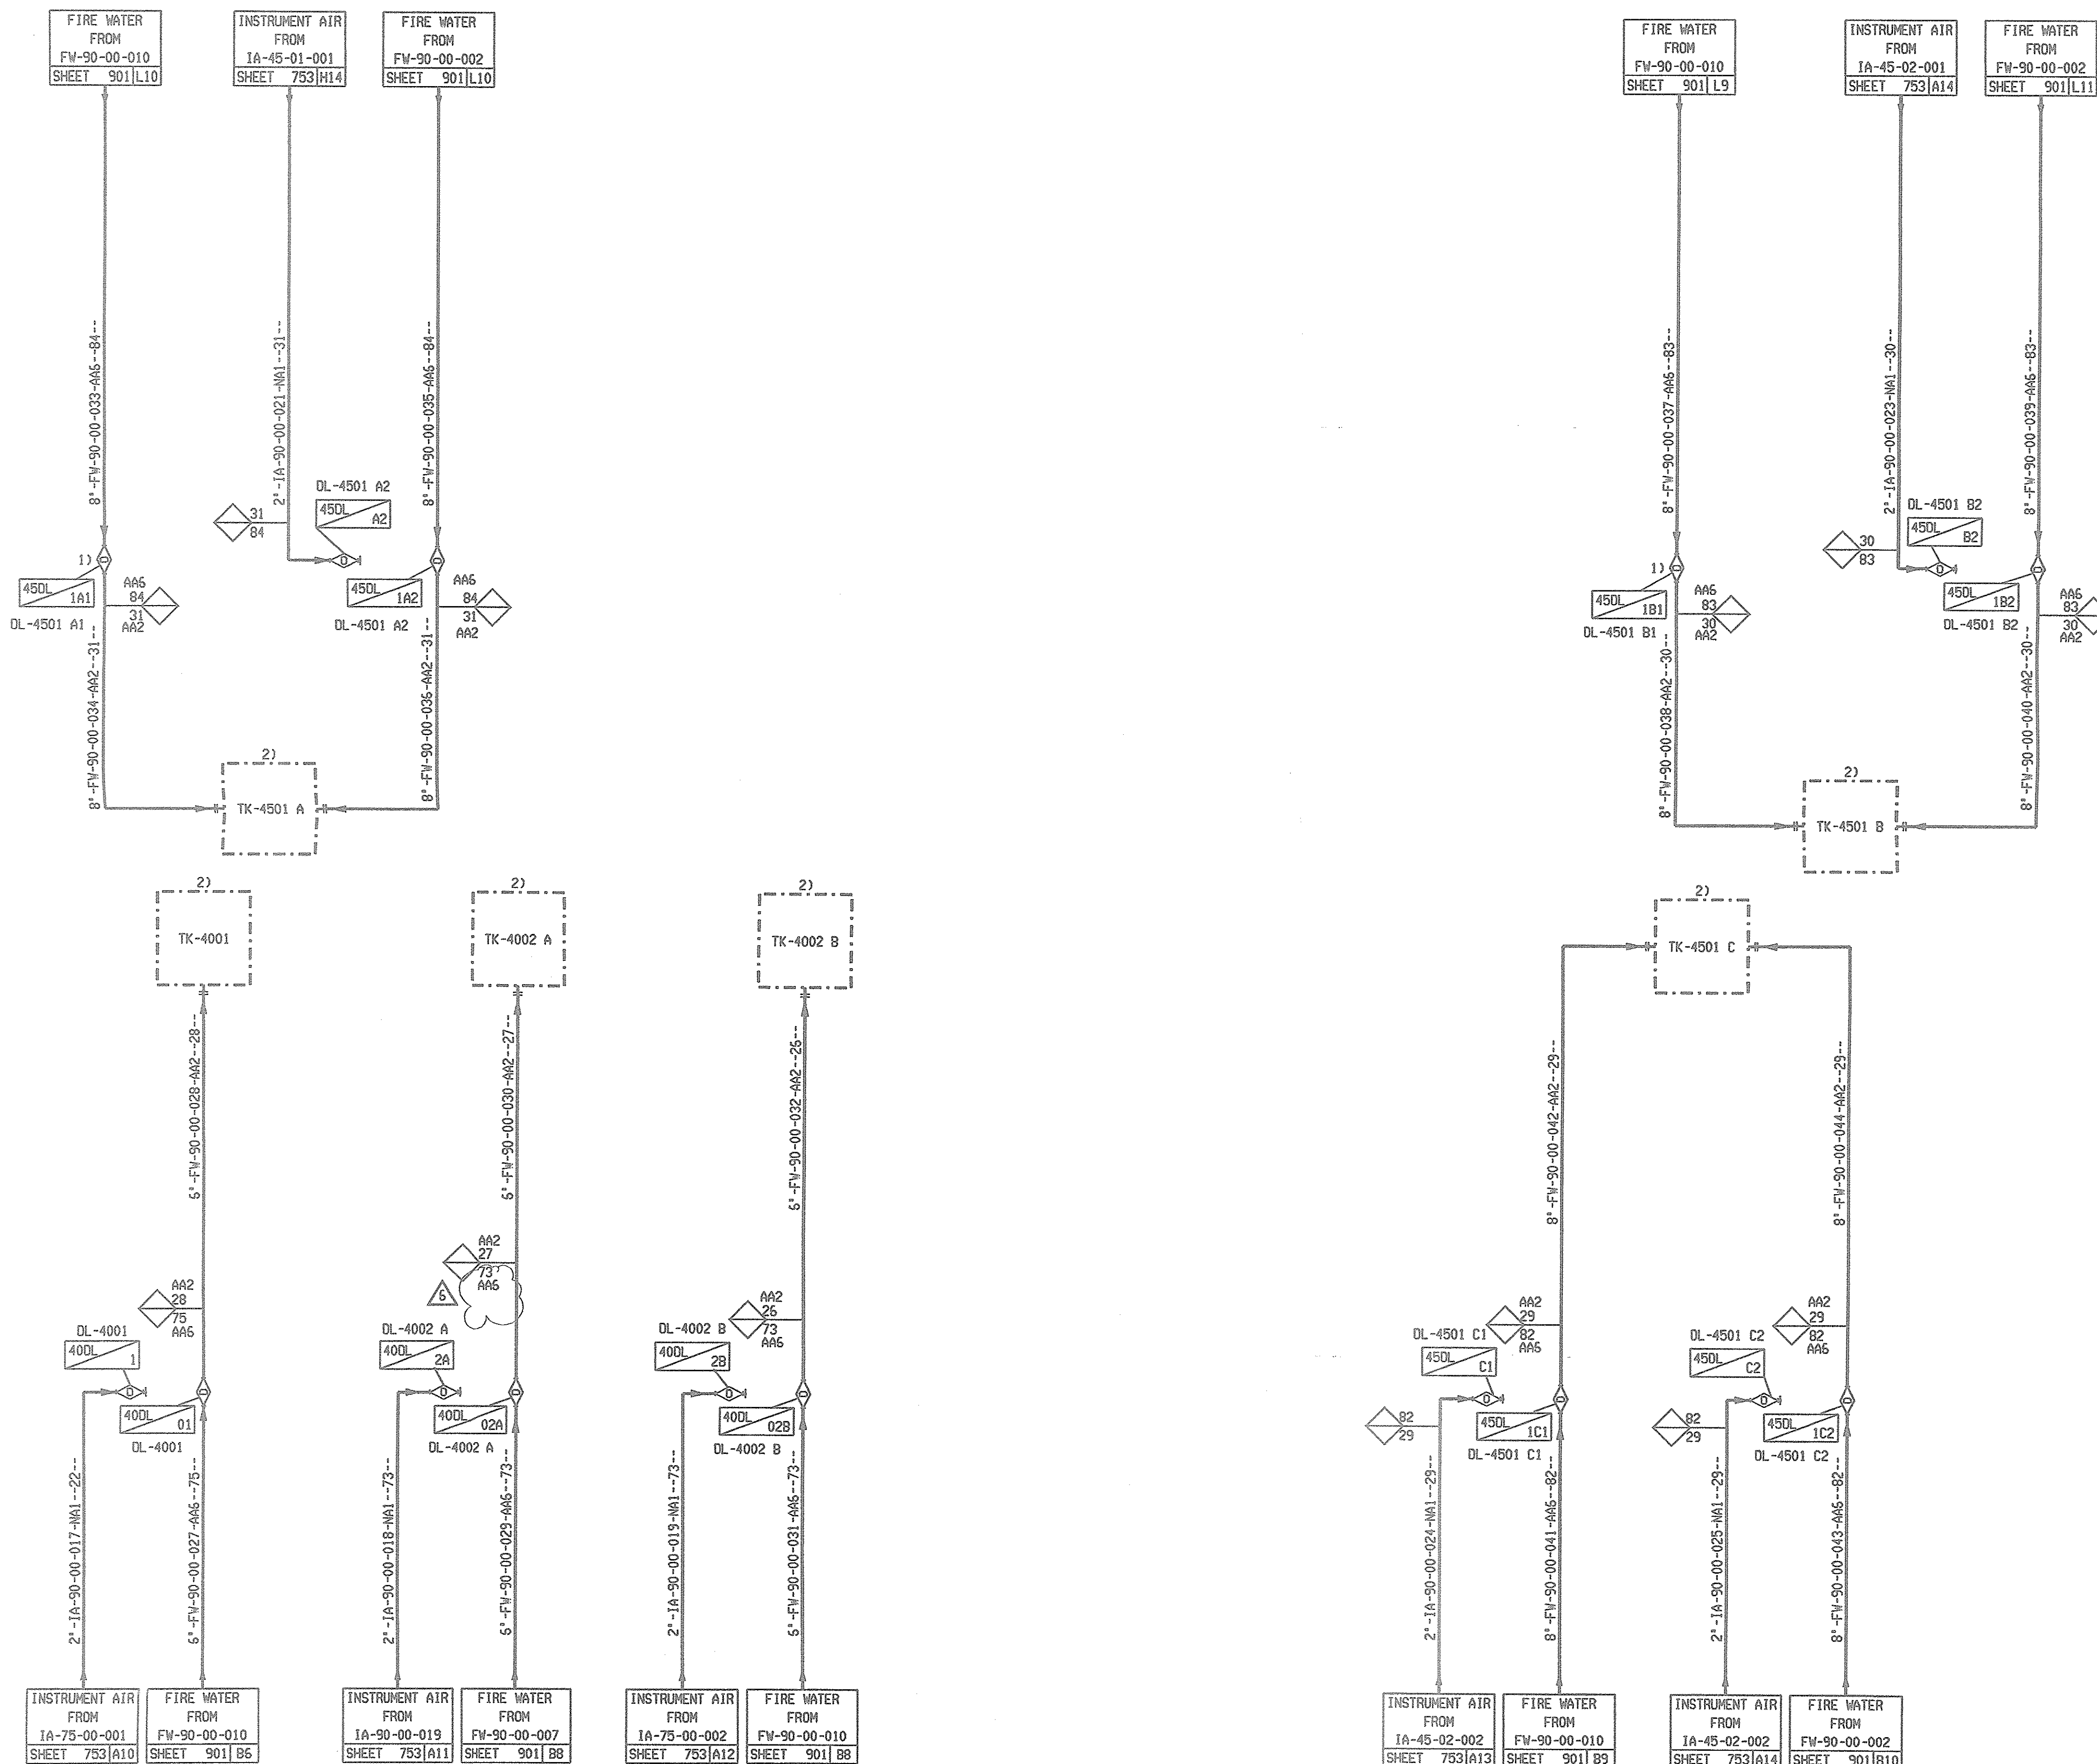


NOTES:

- 1- FOR DETAIL OF DELUGE VALVE SKID, REFER TO VENDOR DRAWINGS.
- 2- FOR DETAILS OF TANK COOLING WATER RINGS, REFER TO TANK VENDOR DRAWINGS

APPROVED FOR
CONSTRUCTION

4TH METHANOL PROJECT/1175

DATE: 24.04.06

BY: [Signature]

6	E.G	22.04.06	S.R	A.R	25.04.06	AFC	REVISED AS MARKED
5	E.G	01.03.06			01.03.06	AFC	NO ISSUE
4	E.G	19.08.03	S.R	M.M	20.08.03	AFC	GENERALLY REVISED
3	E.G	25.05.03	S.R	M.M	27.05.03	AFC	AFC (FROZEN)
2	E.G	08.09.02	S.R	M.M	09.09.02	AFC	AFC WITH HOLD

Rev.	U/P/S	Name	Date	Name	Date	Status	Kind of Revision
	Prepared/Changed			Checked		Approved	

Copying of this document, and giving it to others and the use or communication of the contents thereof, are forbidden without express authority by LURG/PDEC. Offenders are liable to the payment of damages. All rights are reserved in the event of the grant of a patent or the registration of a utility model design.

ZAGROS PETROCHEMICAL COMPANY		OWNER: NATIONAL PETROCHEMICAL COMPANY ZAGROS PETROCHEMICAL COMPLEX شرکت پتروشیمی زاگرس	
DISPOSITION: ☐ NO COMMENT ☐ COMMENTS AS MARKED, FABRICATION CAN PROCEED ACCORDINGLY. REVISED DOCUMENT TO BE ISSUED EITHER FOR REVIEW OR AS FINAL CERTIFIED. HOWEVER ZAGROS WILL CHECK THIS REVISED DOCUMENT FOR PROPER INCORPORATION.		PROJECT: 4th METHANOL PROJECT	
☐ REJECTED DOCUMENT TO BE REISSUED. ☐ USE FOR INFORMATION ONLY.		OWNER: CONTRACTOR: DWG. NO. Rev.	
SIGNATURE: DATE:		CONTRACTOR: PETROCHEMICAL INDUSTRIES DESIGN & ENGINEERING COMPANY شرکت طراحی و مهندسی صنایع پتروشیمی	
ZAGROS REVIEW & COMMENTS DOES NOT ABSOLVE THE VENDOR OF THE RESPONSIBILITY FOR THE CORRECT DESIGN, MANUFACTURING AND OPERATION OF EQUIPMENT.		ZPC PROJ. NO. 40-404277 PDEC PROJ. NO. 1175	
Scale: Original Size:		DWG. NO. P-00-1-PR-203 Rev. 6	
Nomenclature:		engineering Lurgi	
Basic document:		FIRE FIGHTING SYSTEM DELUGE VALVES UTILITY DISTRIBUTION DIAGRAM UDD SHEET 904	
DCC: DG RT DL-No.		Job name: Lurgi Job No. 16966601 Lurgi Document No. 37904 Rev. 6	
MEGA METHANOL IRAN		d.37904.pld 002 13.01.04 CHAVANTINI POSHKS3	